


CONFIDENTIAL & PROPRIETARY

All data contained in this document is sole property of **DRY SYSTEMS TECHNOLOGIES** and is considered confidential and proprietary.

This document may not be reproduced, released to third parties, or used for purposes other than for which it was furnished, without express written consent of **DRY SYSTEMS TECHNOLOGIES**.

DRY SYSTEMS TECHNOLOGIES.

This document remains property of **DRY SYSTEMS TECHNOLOGIES** and must be returned upon request.

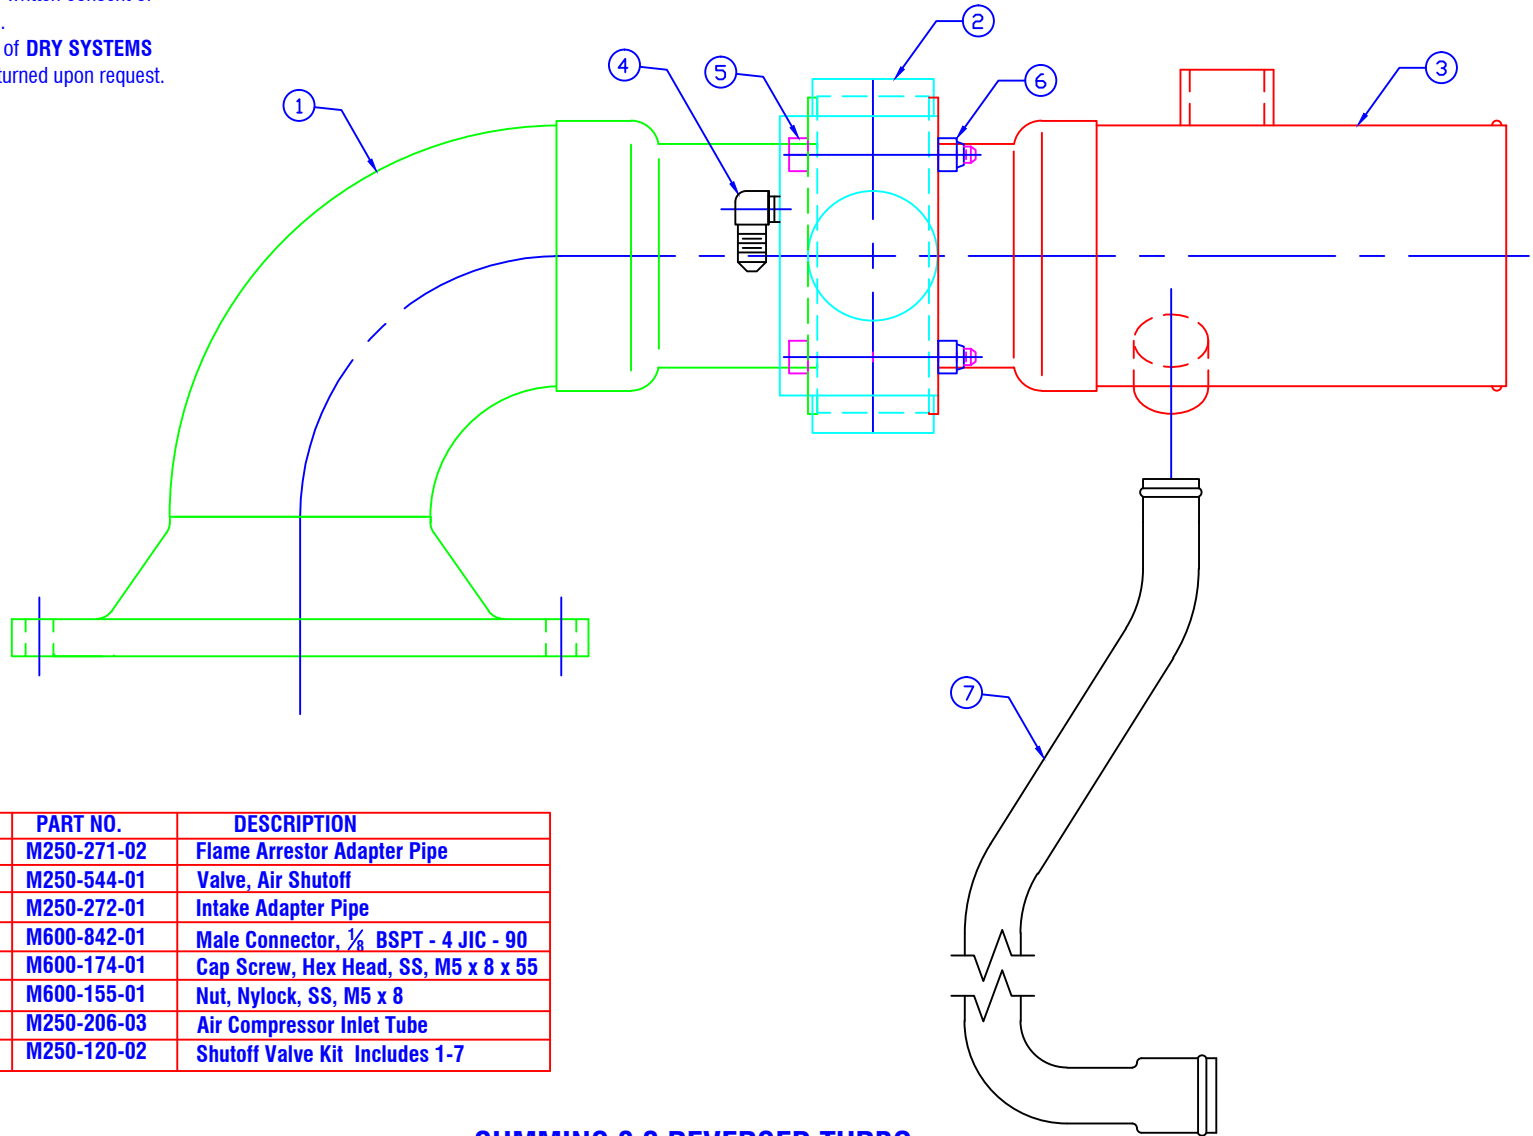

| ITEM NO. | QTY. | PART NO. | DESCRIPTION |
|----------|------|-------------|---------------------------------------|
| 1 | 1 | M250-271-02 | Flame Arrestor Adapter Pipe |
| 2 | 1 | M250-544-01 | Valve, Air Shutoff |
| 3 | 1 | M250-272-01 | Intake Adapter Pipe |
| 4 | 1 | M600-842-01 | Male Connector, 1/8 BSPT - 4 JIC - 90 |
| 5 | 4 | M600-174-01 | Cap Screw, Hex Head, SS, M5 x 8 x 55 |
| 6 | 4 | M600-155-01 | Nut, Nylock, SS, M5 x 8 |
| 7 | 1 | M250-206-03 | Air Compressor Inlet Tube |
| | 1 | M250-120-02 | Shutoff Valve Kit Includes 1-7 |

CUMMINS 8.3 REVERSED TURBO

| TOLERANCES | |
|---------------------|--|
| Linear unless noted | |
| Machined: ±0.005 | |
| Fabricated: ±0.02 | |
| Angular: ±1/2° | |
| Surface finish 125 | |

DRY SYSTEMS TECHNOLOGIES
 8102 LEMONT ROAD, SUITE 700
 WOODRIDGE, IL 60517
 Phone: 630-427-2051 Fax: 630-427-1036
 E-Mail: eng@drysystemstech.com

| DESCRIPTION | | NO RECD |
|-----------------------------|-------------|----------|
| Shut-Off Valve Installation | | 1 |
| SCALE | DATE | DRAWN BY |
| FULL | 5/24/19 | JLW |
| MATERIAL | APPROVED BY | |
| See Detail Drawings | | |
| DRAWING NO | | |

SECTION 2-04

