


CONFIDENTIAL & PROPRIETARY

All data contained in this document is sole property of **DRY SYSTEMS TECHNOLOGIES** and is considered confidential and proprietary.

This document may not be reproduced, released to third parties, or used for purposes other than for which it was furnished, without express written consent of **DRY SYSTEMS TECHNOLOGIES**.

This document remains property of **DRY SYSTEMS TECHNOLOGIES** and must be returned upon request.

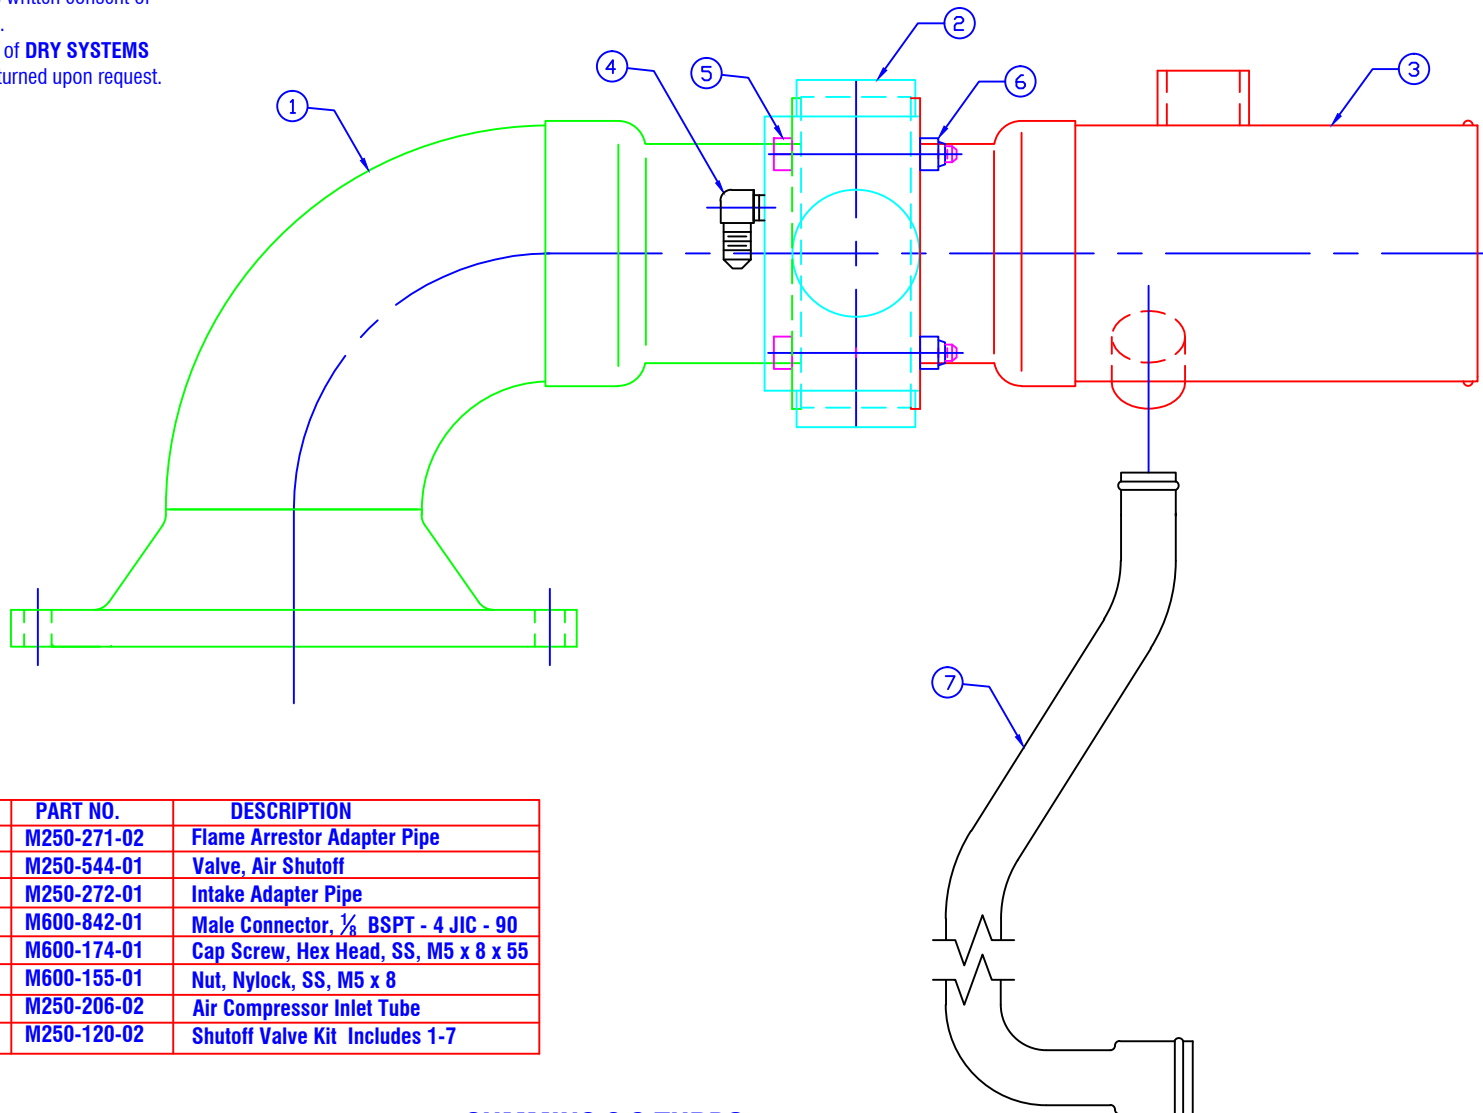

ITEM NO.	QTY.	PART NO.	DESCRIPTION
1	1	M250-271-02	Flame Arrestor Adapter Pipe
2	1	M250-544-01	Valve, Air Shutoff
3	1	M250-272-01	Intake Adapter Pipe
4	1	M600-842-01	Male Connector, 1/8" BSPT - 4 JIC - 90
5	4	M600-174-01	Cap Screw, Hex Head, SS, M5 x 8 x 55
6	4	M600-155-01	Nut, Nylock, SS, M5 x 8
7	1	M250-206-02	Air Compressor Inlet Tube
	1	M250-120-02	Shutoff Valve Kit Includes 1-7

CUMMINS 8.3 TURBO

SECTION 2-04

TOLERANCES	REV	DATE	NAME	DESCRIPTION
Linear unless noted				
Machined: ±0.005				
Fabricated: ±0.02				
Angular: ±1/2°				
Surface finish 125				

DRY SYSTEMS TECHNOLOGIES
 8102 LEMONT ROAD, SUITE 700
 WOODRIDGE, IL 60517
 Phone: 630-427-2051 Fax: 630-427-1036
 E-Mail: eng@drysystemstech.com

DESCRIPTION		NO RECD
Shut-Off Valve Installation		1
SCALE	DATE	DRAWN BY
FULL	Mar 25 2015	Ward Fox
MATERIAL	APPROVED BY	
See Detail Drawings		
DRAWING NO		
M250-120-01		

