


**CONFIDENTIAL & PROPRIETARY**

All data contained in this document is sole property of DRY SYSTEMS TECHNOLOGIES and is considered confidential and proprietary.  
 This document may not be reproduced, released to third parties, or used for purposes other than for which it was furnished, without express written consent of DRY SYSTEMS TECHNOLOGIES.  
 This document remains property of DRY SYSTEMS TECHNOLOGIES and must be returned upon request.

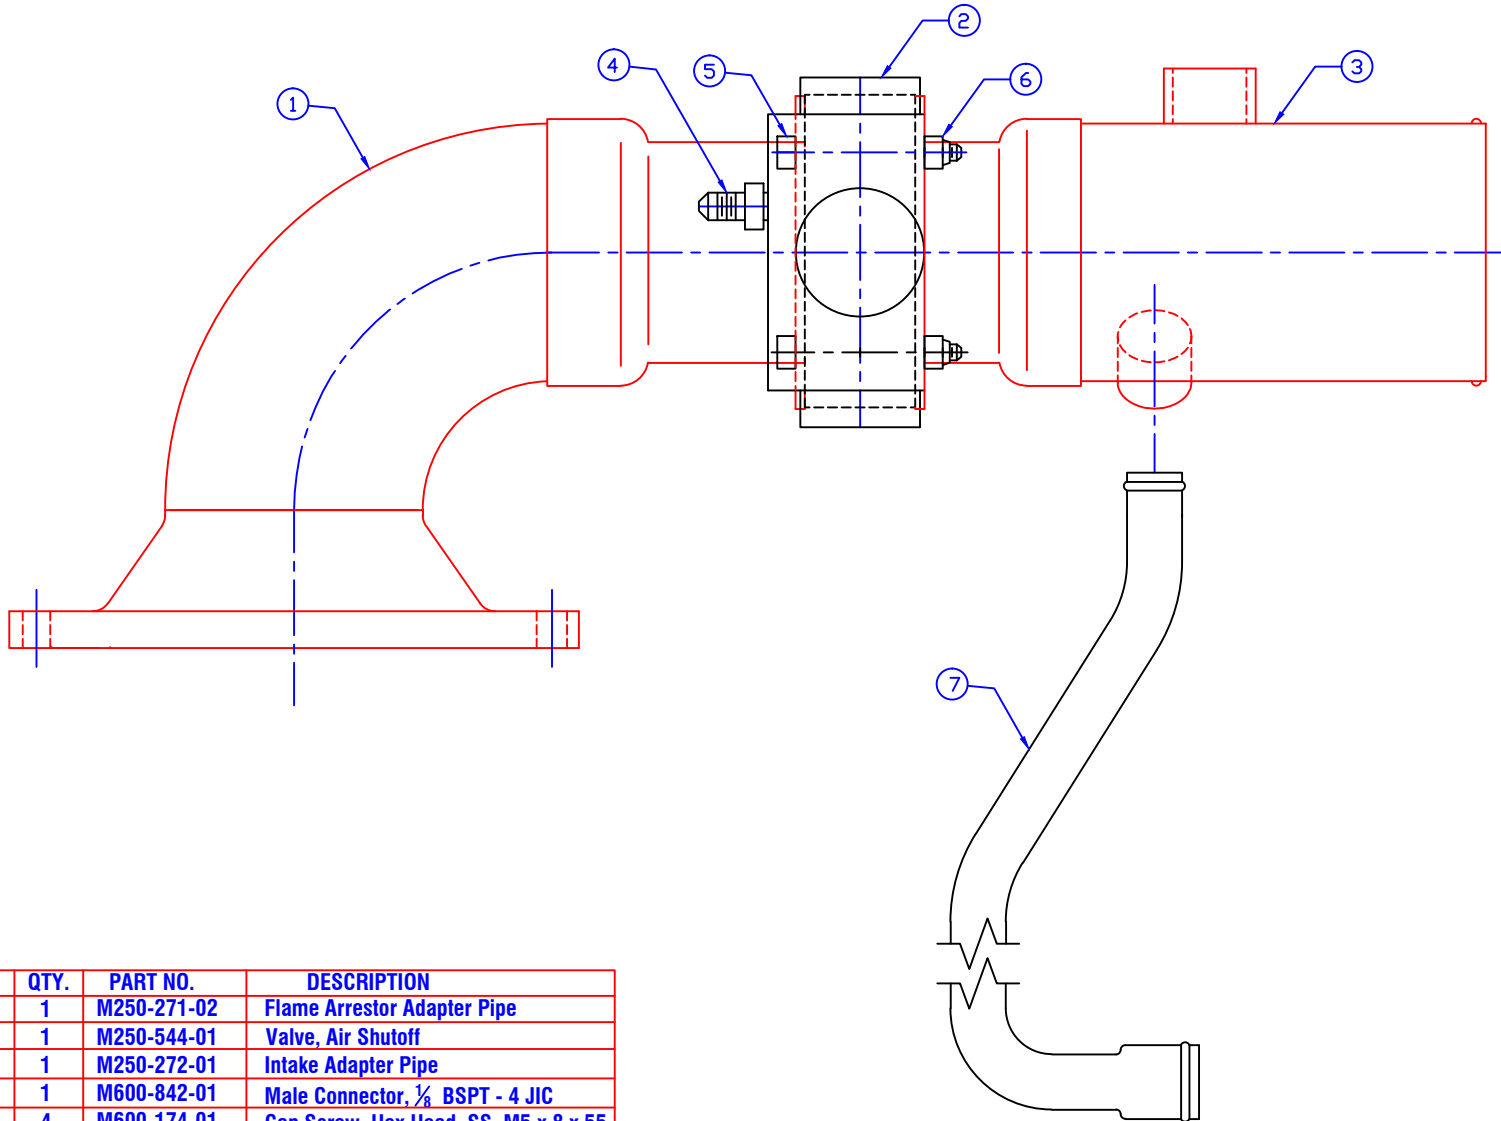

ITEM NO.	QTY.	PART NO.	DESCRIPTION
1	1	M250-271-02	Flame Arrester Adapter Pipe
2	1	M250-544-01	Valve, Air Shutoff
3	1	M250-272-01	Intake Adapter Pipe
4	1	M600-842-01	Male Connector, 1/8" BSPT - 4 JIC
5	4	M600-174-01	Cap Screw, Hex Head, SS, M5 x 8 x 55
6	4	M600-155-01	Nut, Nylock, SS, M5 x 8
7	1	M250-206-02	Air compressor Inlet Tube
	1	M250-120-02	Shutoff Valve Kit Includes 1-7

**TOLERANCES**  
 Linear unless noted  
 Machined: ±0.005  
 Fabricated: ±0.01  
 Angular: ±1/2°  
 Surface finish 125

REV	DATE	NO	DESCRIPTION
02	8/29/16	WEF	Added temp sensor coupling
01	12/9/15	WEF	Change M600-842-01 to a 90 deg

**DRY SYSTEMS TECHNOLOGIES**  
 10420 RISING COURT  
 WOODRIDGE, IL 60517  
 Phone: 630-427-2051 Fax: 630-427-1036  
 E-Mail: emp@drysystemstech.com

DESCRIPTION		NO REQD
SHUT-OFF VALVE INSTALLATION		1
SCALE	DATE	DRAWN BY
FULL	25 March 2015	W Fox
MATERIAL	APPROVED BY	
DRAWING NO.	M250-120-01	

